

Trinity College Dual Temp to Austin Arts




ESTABLISHED 1879

Phase 1: Mobilization

May 22nd - June 2nd



June 5th - July 14th

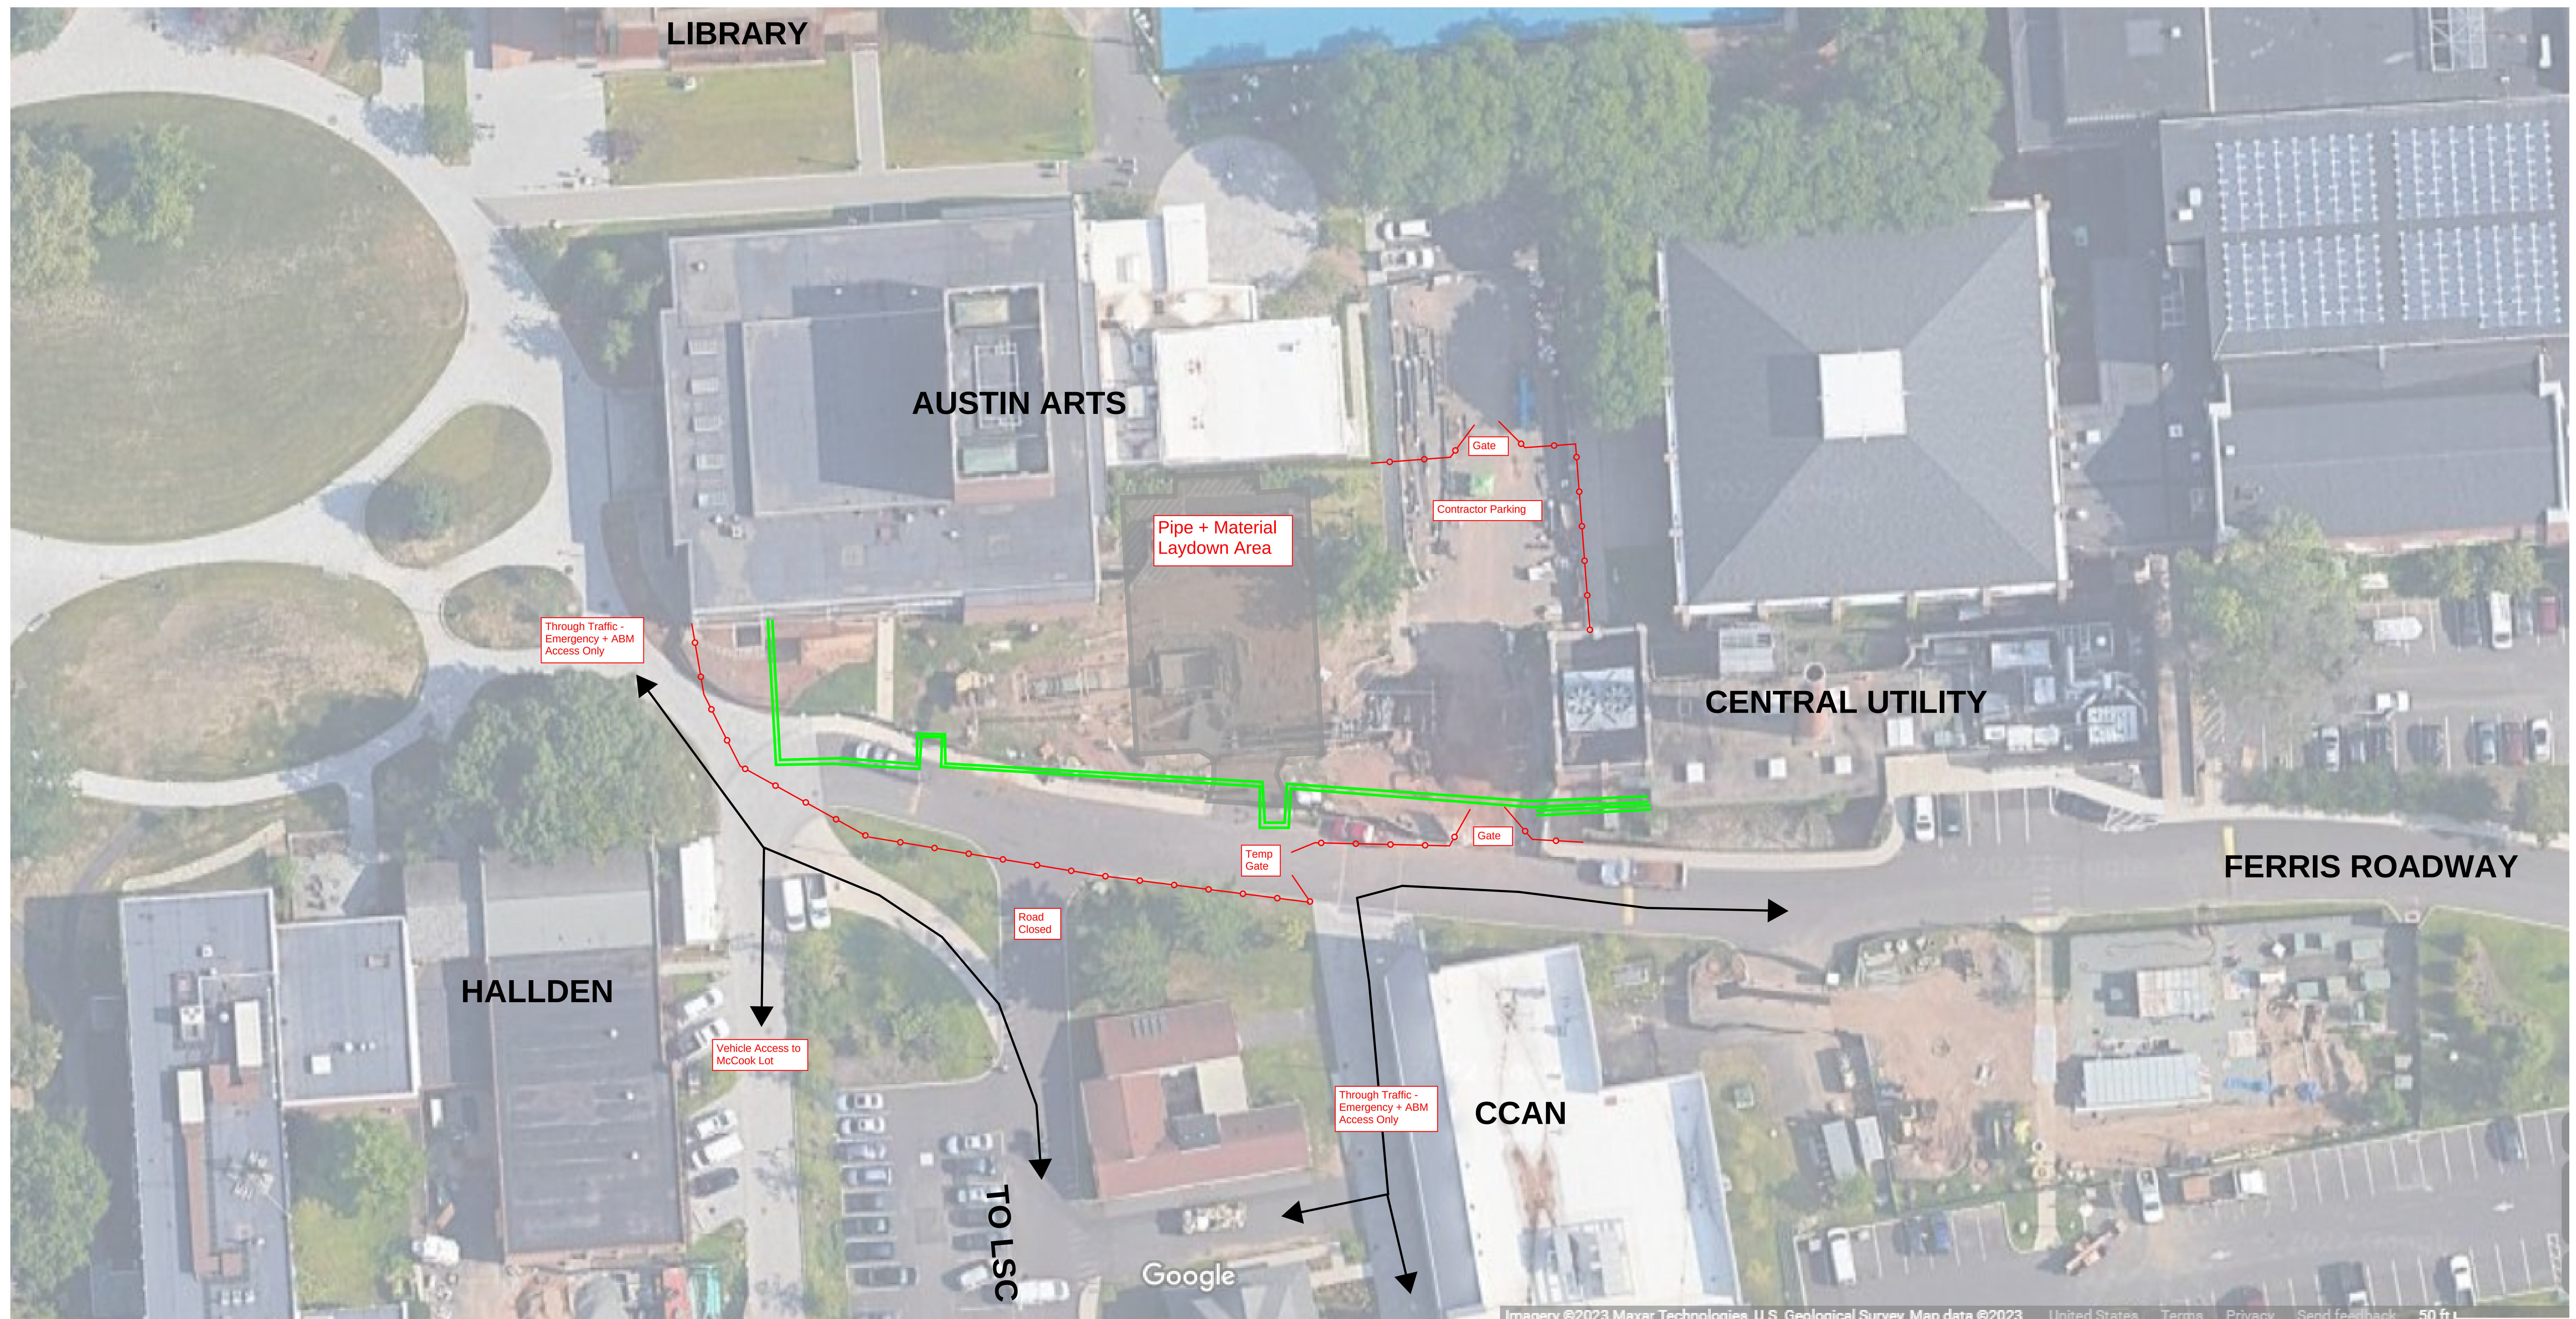

Trinity College Dual Temp to Austin Arts



ESTABLISHED 1879

Phase 3: Pipe Installation to Central Utility

July 17th - Aug 25th



Trinity College Dual Temp to Austin Arts




ESTABLISHED 1879

Phase 4: Building Tie in and Scheduled Shutdown

Oct 9th - Nov 3rd




12/19/22 9:22:02 AM W:\2022\226201203 - Trinity College Dual Temp To Austin Arts DWG5\226201203-utility.dwg

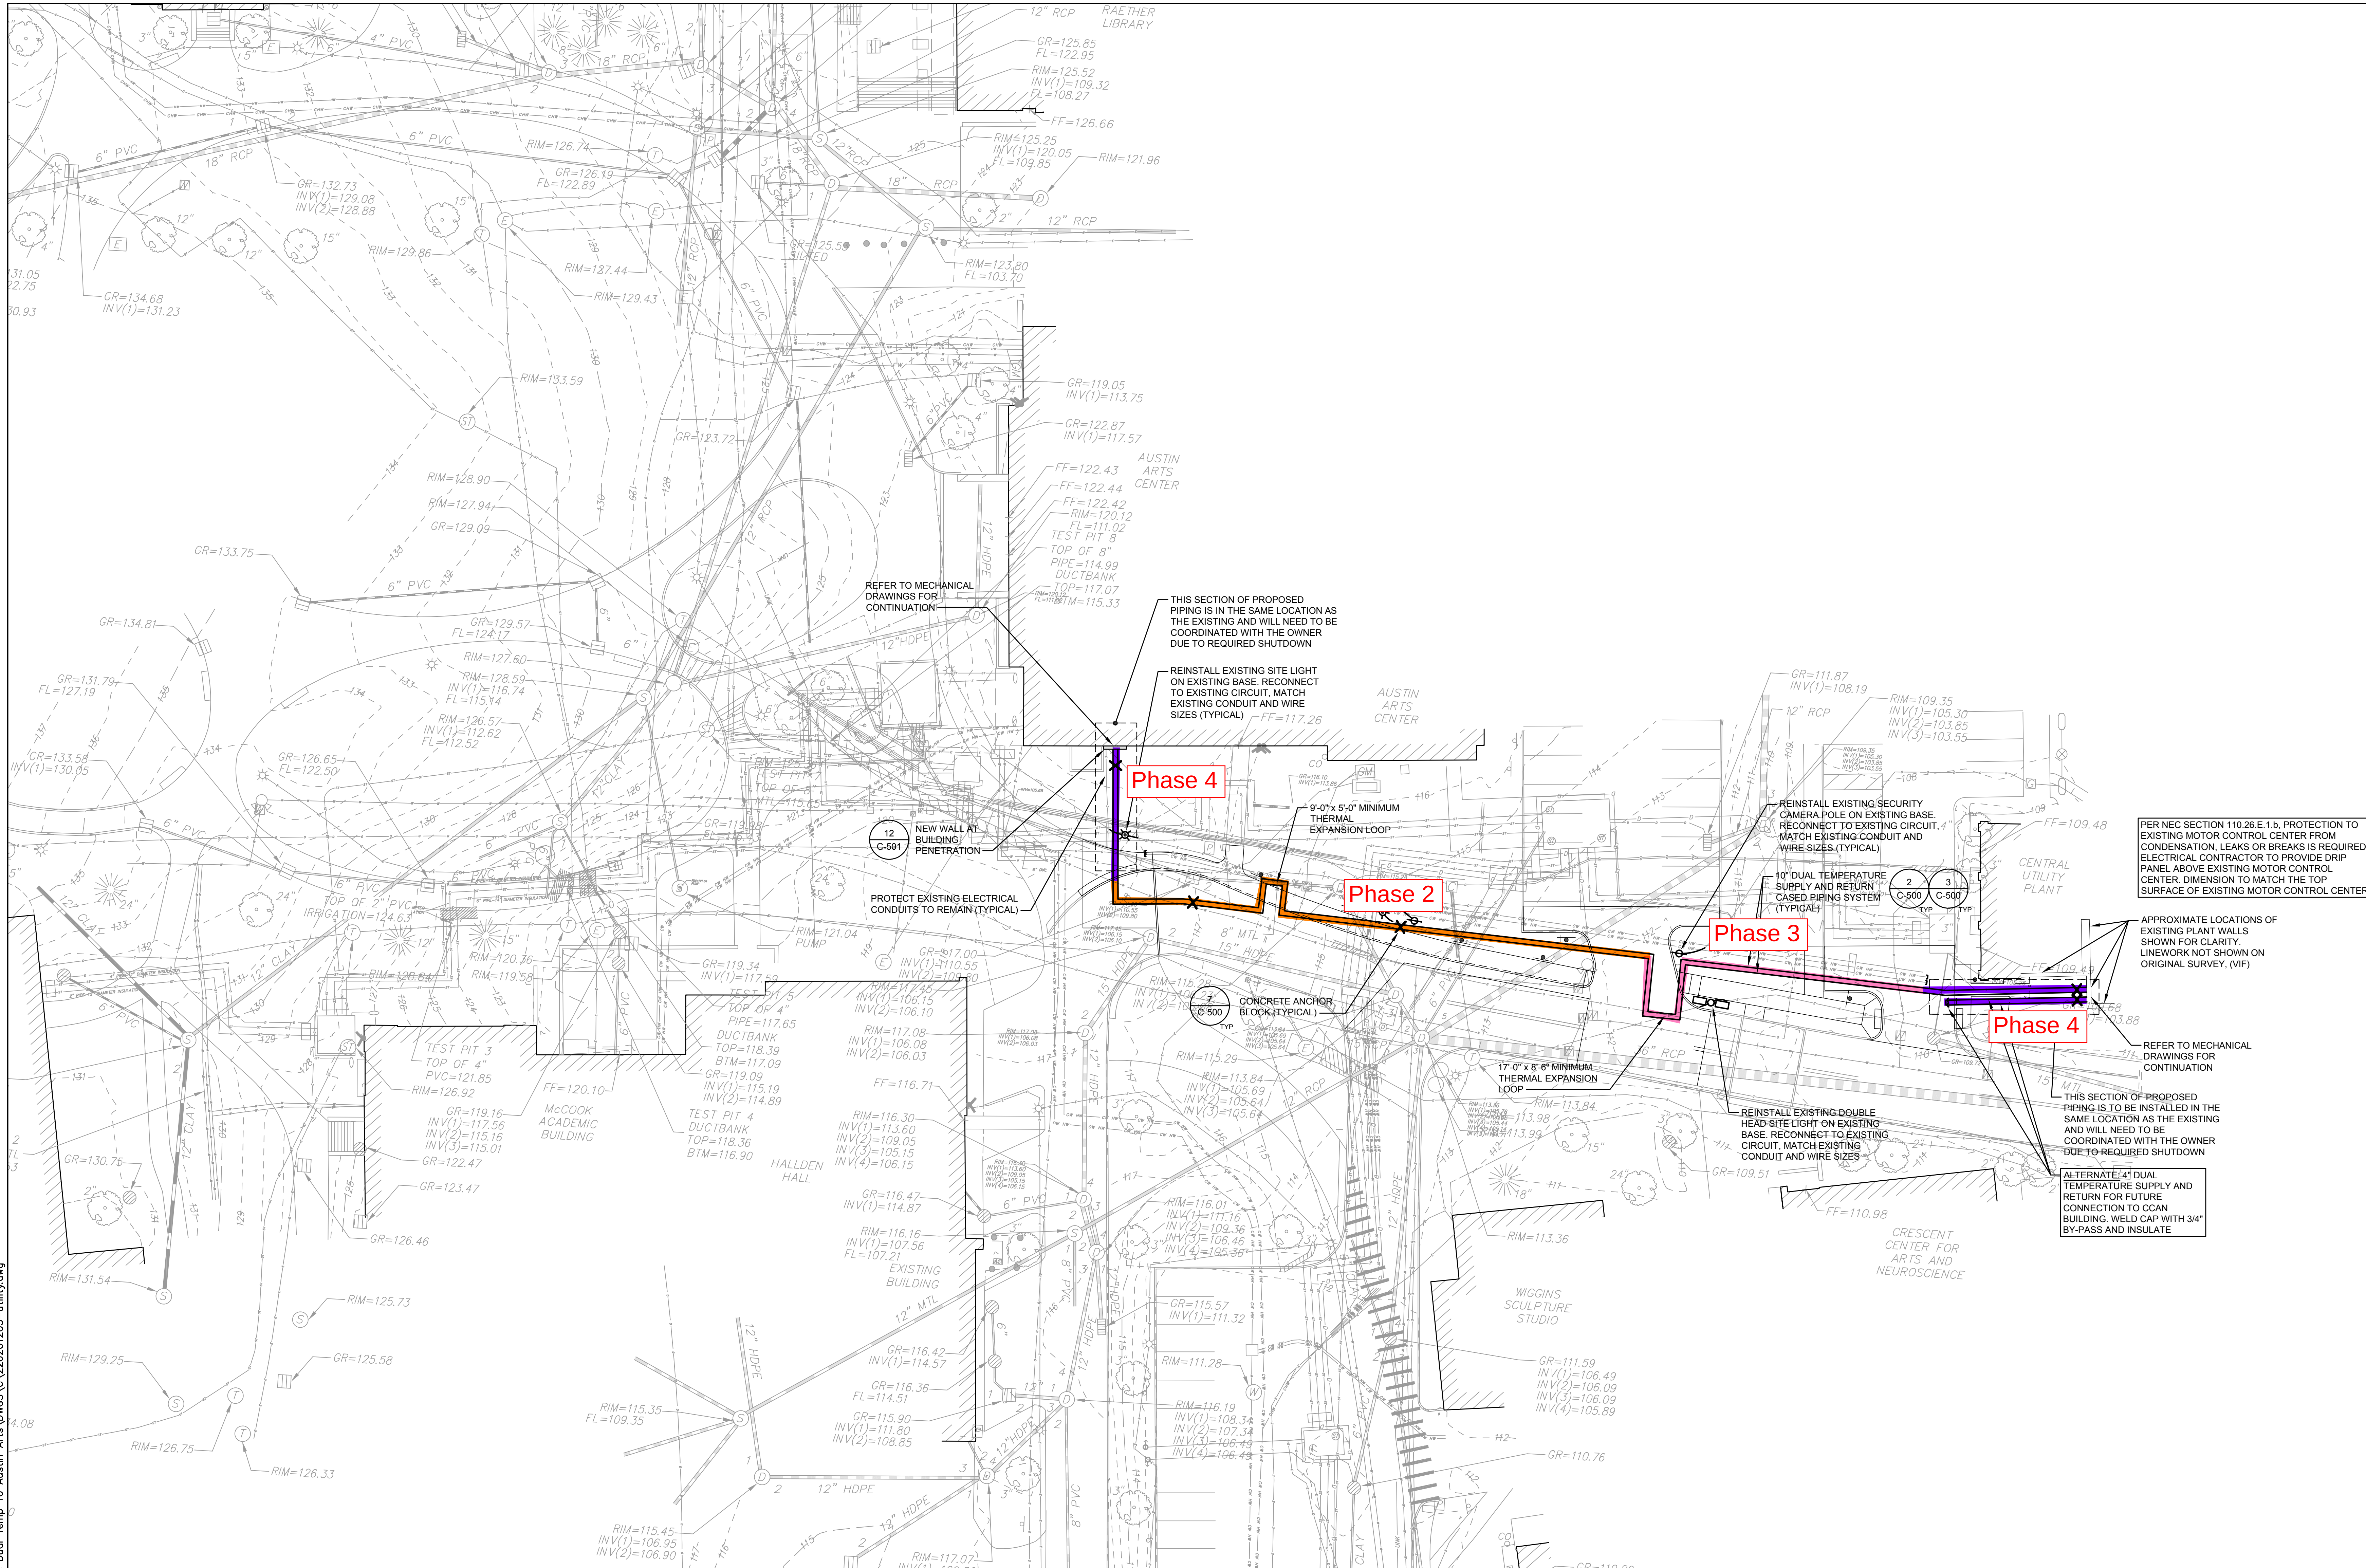


UTILITY GENERAL NOTES:

- ALL SITE DISTURBANCE DUE TO LAYOUT OF SITE LIGHTING WIRING SHALL BE RESTORED TO EXISTING CONDITIONS.
- FOR UTILITY TRENCH DETAILS, REFER TO 1/C-500 AND 2/C-500.
- EXISTING MANHOLES ARE TO BE RESET AS REQUIRED TO MATCH NEW GRADES.
- FINAL TOP OF FRAME ELEVATIONS FOR NEW UTILITY STRUCTURES MAY NEED TO BE FIELD ADJUSTED TO COORDINATE WITH SITE CONDITIONS AND FINAL GRADING (TYPICAL).
- FIELD VERIFY PROPOSED CONNECTIONS TO EXISTING UTILITY SYSTEMS PRIOR TO INSTALLING PROPOSED WORK.
- VALVES AT BUILDING ENTRIES ARE SPECIFIED IN SPECIFICATION SECTION 232113-13 "UNDERGROUND HYDRONIC PIPING".



GRAPHIC SCALE

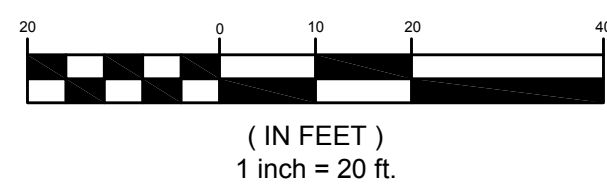

REVISIONS		
NO.	DATE	ISSUE

DATE	12/18/2022
SCALE	1"=20'
DRAWN	CC/CA
CHECKED	JRV
JOB NO.	226201203

SHEET TITLE:

SITE UTILITY
PLAN

C-300